


Specifications and Ordering Information 330400 and 330425 Accelerometer Acceleration Transducers

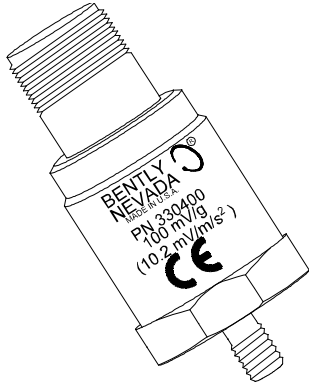

Description

These accelerometers are intended for critical machinery applications where casing acceleration measurements are required, such as gear mesh monitoring. The 330400 is designed to address the requirements of American Petroleum Institute Standard 670 for accelerometers. It provides an amplitude range of 50 g peak and a sensitivity of 100 mV/g. The 330425 is identical except it provides a larger amplitude range (75 g peak) and a sensitivity of 25 mV/g.

Caution

If housing measurements are being made for overall protection of the machine, thought should be given to the usefulness of the measurement for each application. Most common machine malfunctions (imbalance, misalignment, etc.) originate at the rotor and cause an increase (or at least a change) in rotor vibration. In order for any housing measurement alone to be effective for overall machine protection, a significant amount of rotor vibration must be faithfully transmitted to the bearing housing or machine casing, or more specifically, to the mounting location of the transducer.

In addition, care should be exercised in the physical installation of the transducer. Improper installation can result in a degradation of the transducer's performance, and/or the generation of signals which do not represent actual machine vibration. Integration of the output to velocity can worsen this. Extreme caution should be exercised if integrating to velocity. For high quality velocity measurements the 330500 Velomitor® Sensor should be used.

Upon request, Bently Nevada can provide engineering services to determine the appropriateness of housing measurements for the machine in question and/or to provide installation assistance.

Specifications

Parameters are specified from +20 to +30 °C (+68 to +86 °F) and 100 Hz unless otherwise indicated.

Note: Operation outside the specified limits may result in false readings or loss of machine monitoring.

Electrical

330400

Sensitivity: 10.2 mV/m/s² (100 mV/g) ±5%.



Acceleration range: 490 m/s² (50 g) peak overall acceleration within the 10 Hz to 15 kHz frequency span. Vibration at frequencies above 15 kHz, especially at the transducers resonance will significantly decrease this range.

Amplitude Linearity: ±1% to 490 m/s² (50 g) peak.

Broadband Noise Floor (10 Hz to 15 kHz): 0.039 m/s² (0.004 g) rms.

330425

Sensitivity: 2.5 mV/m/s² (25 mV/g) ±5%.

Acceleration Range: 735 m/s² (75 g) peak overall acceleration within the 10 Hz to 15 kHz frequency span. Vibration at frequencies above 15 kHz, especially at the transducer's resonance, will significantly decrease this range.

Amplitude Linearity: ±1% to 735 m/s² (75 g) peak.

Broadband Noise Floor (10 Hz to 15 kHz): 0.098 m/s² (0.01 g) rms.

Both Units

Frequency Response: 10 Hz to 15 kHz (600 cpm to 900,000 cpm) ±3dB; 30 Hz to 10 kHz (1800 cpm to 600,000 cpm) ±10%

Temperature Sensitivity: -11% to +3% typical over the operating temperature range.

Transverse Sensitivity: Less than 5% of axial.

Mounted Resonant Frequency: Greater than 30 kHz.

Amplitude of Resonant Peak: 20 dB maximum.

Base Strain Sensitivity:

For serial numbers preceded by the letter "G" (including all new sensors): 49 mm/s²/μstrain (0.005 g/μstrain)

For serial numbers NOT preceded by the letter "G" (shipped prior to April 2004): 980 mm/s²/μstrain (0.100 g/μstrain) without Mounting Base (API adapter); 4.9 mm/s²/μstrain (0.0005 g/μstrain) with Mounting Base (API adapter) supplied with the accelerometer.

Note: Bently Nevada recommends installing with the Mounting base to minimize base strain sensitivity for serial numbers NOT preceded by the letter "G".

Maximum cable length: 305 metres (1000 ft) with no degradation of signal.

Power requirements:

Input Voltage -24 ± 0.5 Vdc.

Bias Current: 2 mA nominal.

Output Bias Voltage: -8.5 ± 0.5 Vdc.

Grounding: Case isolated.

Hazardous Area Approvals

Multiple approvals for hazardous areas certified by Canadian Standards Association (CSA/NRTL/C) in North America and by LCIE in Europe.

North America: Ex ia/AEx ia for Class I Zone 0 IIC T4 or Division 1, Groups A,B,C,D, when installed with an approved zener barrier or galvanic isolator per BN drawing 167538.

Ex nL/AEx nL Class I Zone 2 IIC T4 or Division 2 when installed without barriers per drawing 167538. Approvals pending for Class II and Class III. T4 @ Ta = 100 °C (212 °F).

16925	3-conductor shielded 22 AWG (0.5 mm ²) cable with 3-socket plug at one end, terminal lugs at the other end. Minimum length of 2.0 ft (0.6 m), maximum length of 99 ft (30 m).	00531080	Mating connector for 330400 and 330425 Accelerometers.
16710	3-conductor shielded 22 AWG (0.5 mm ²) armored cable with 3-socket plug at one end, terminal lugs at the other end. Minimum length of 3.0 ft (0.9 m), maximum length of 99 ft (30 m).	37439-01	For use with serial numbers NOT preceded with the letter "G". Mounting Base, ¼-28 to ¼-28. Reduces base strain sensitivity.
Accessories		37439-02	For use with serial numbers NOT preceded with the letter "G". Mounting Base, M8X1 to M8X1. Reduces base strain sensitivity.
127088-01	330400 and 330425 Accelerometer Operations Manual.	43217	Accelerometer Mounting Kit used with extension part number 108576-01 and O-ring part number 04290422 to allow room for the 330400 or 330425 accelerometer. (See separate datasheet, p/n 141630-01.)

© 2004 Bently Nevada, LLC.
 ® used in this document are registered marks of Bently Nevada, LLC.

Dimensional drawing

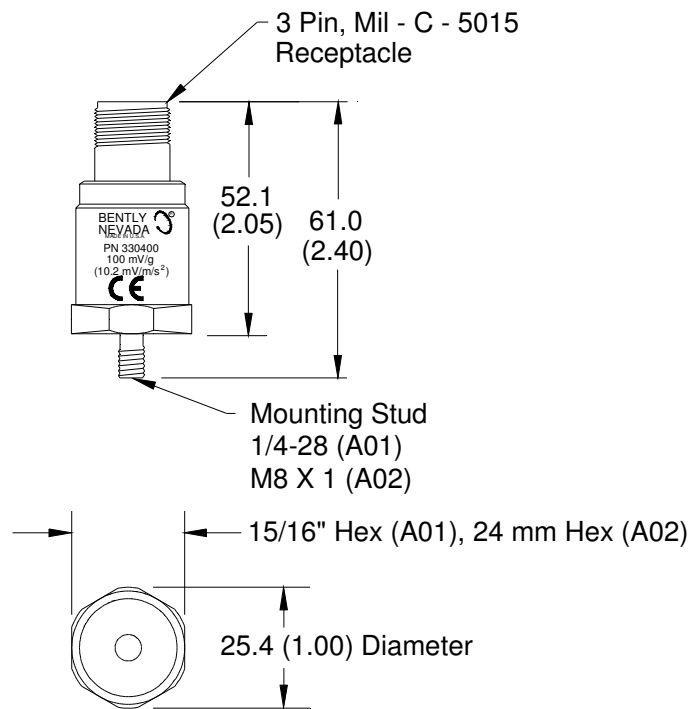


Figure 1: Acceleration Transducer dimensional drawing
Dimensions are in millimetres (inches)

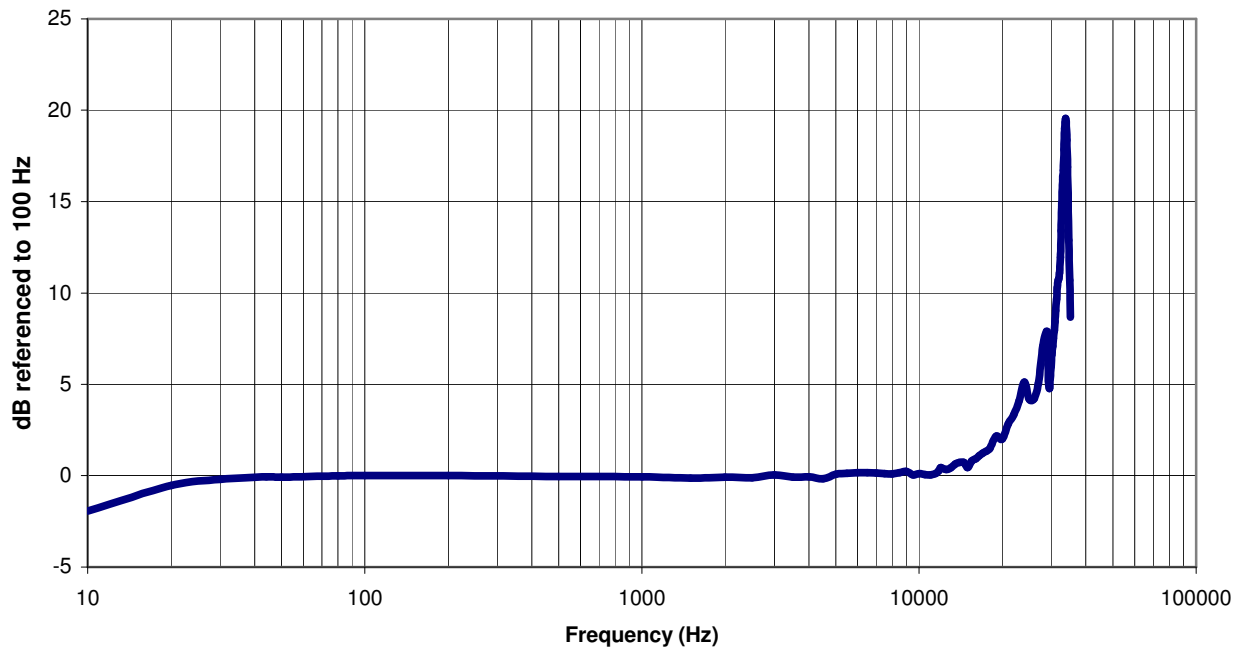


Figure 2: Typical Amplitude Response

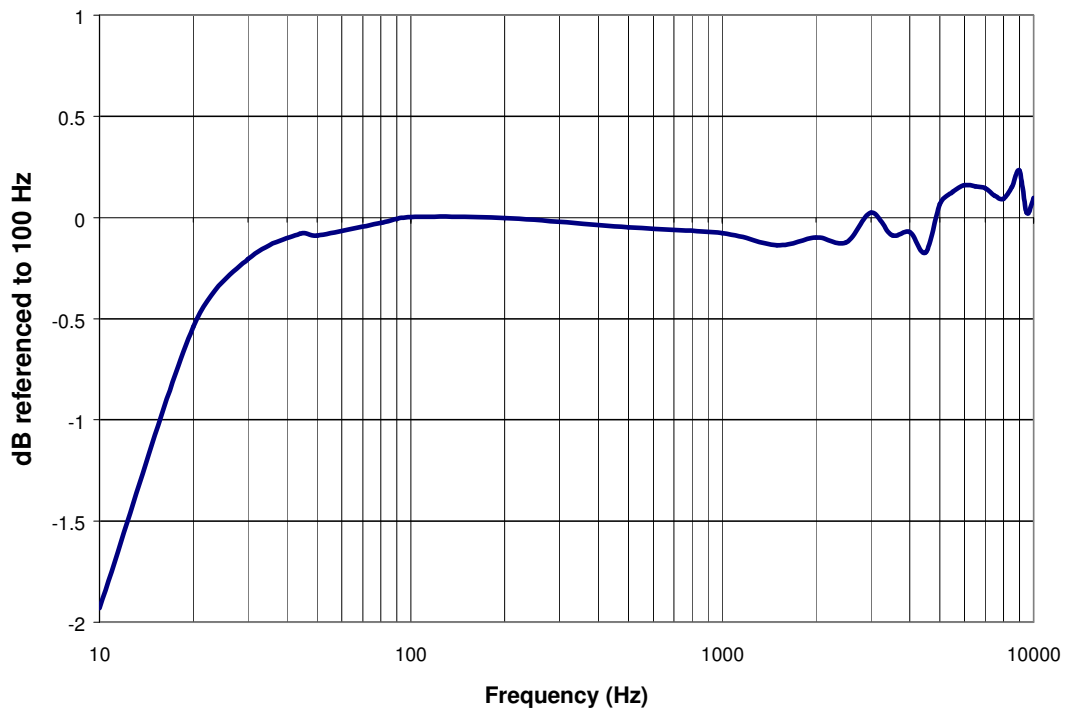


Figure 3: 10 – 10,000 Hz Typical Amplitude Response Detail